

Applicant: Micak et al.; Attorney Docket: 60246-347; Express Mail No. EV235994807US

1/3



FIG. 1

Effect of Improper Shut-down and Start-up on Refrigeration Equipment with
regard to kW Average

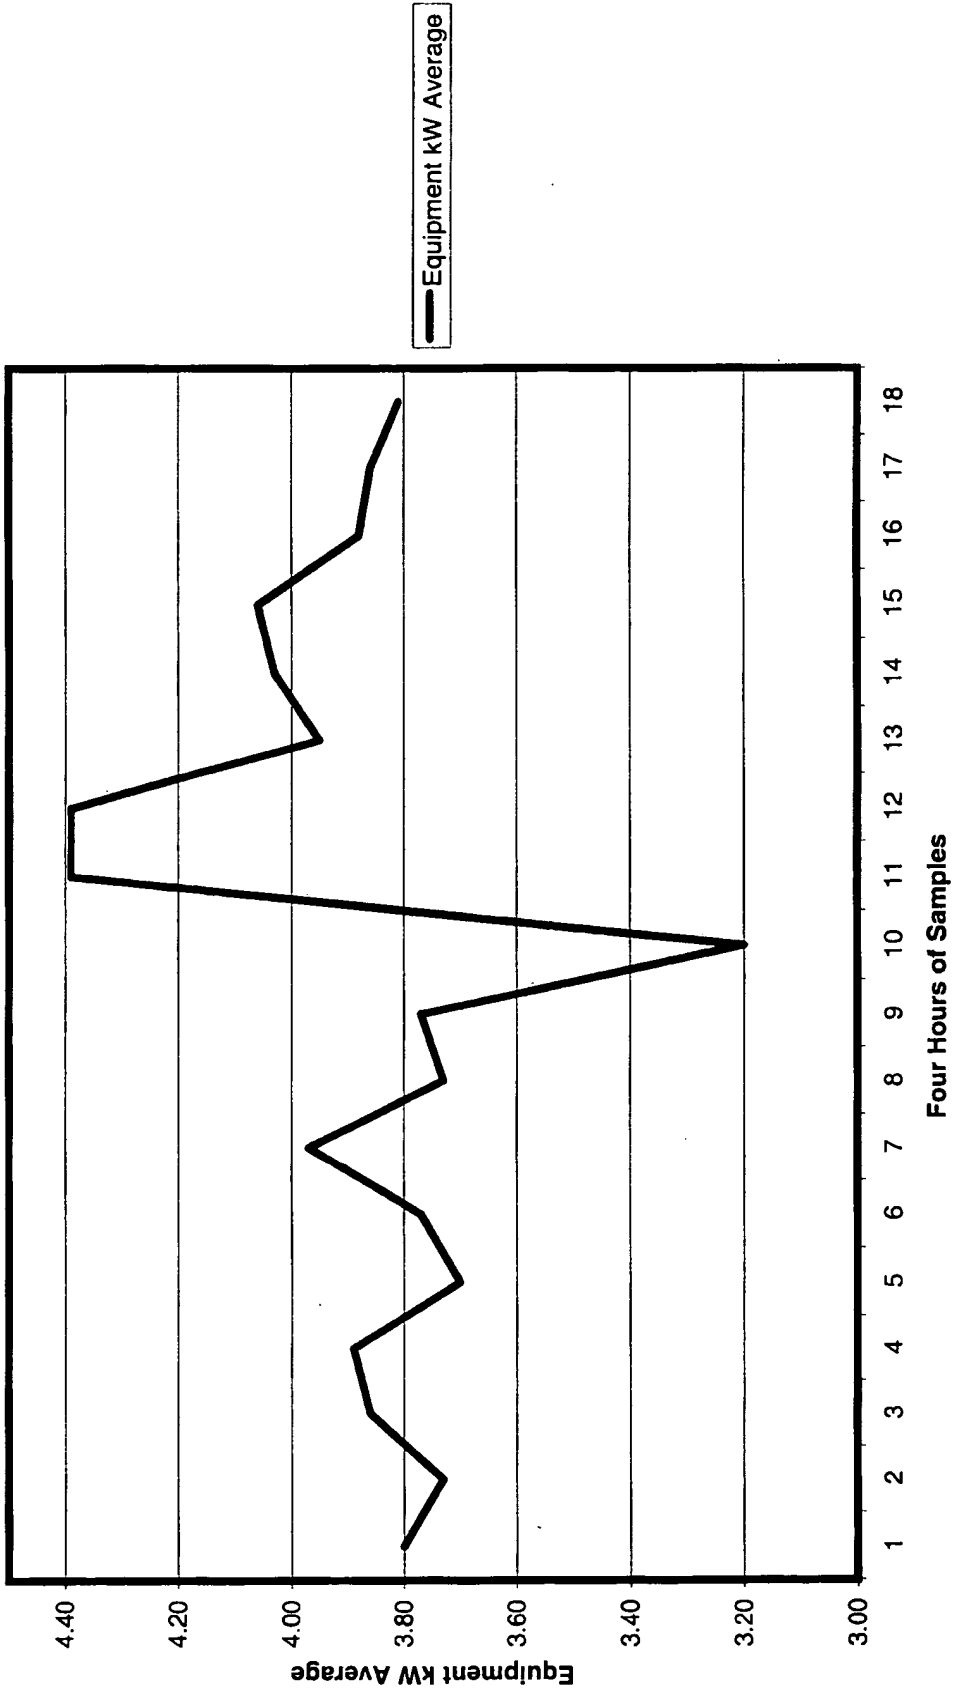


FIG. 2

Effect of Improper Shut-down and Start-up on Refrigeration Equipment with regard to freezer temperatures when evap shut-off switch was left off, and then turned back on.

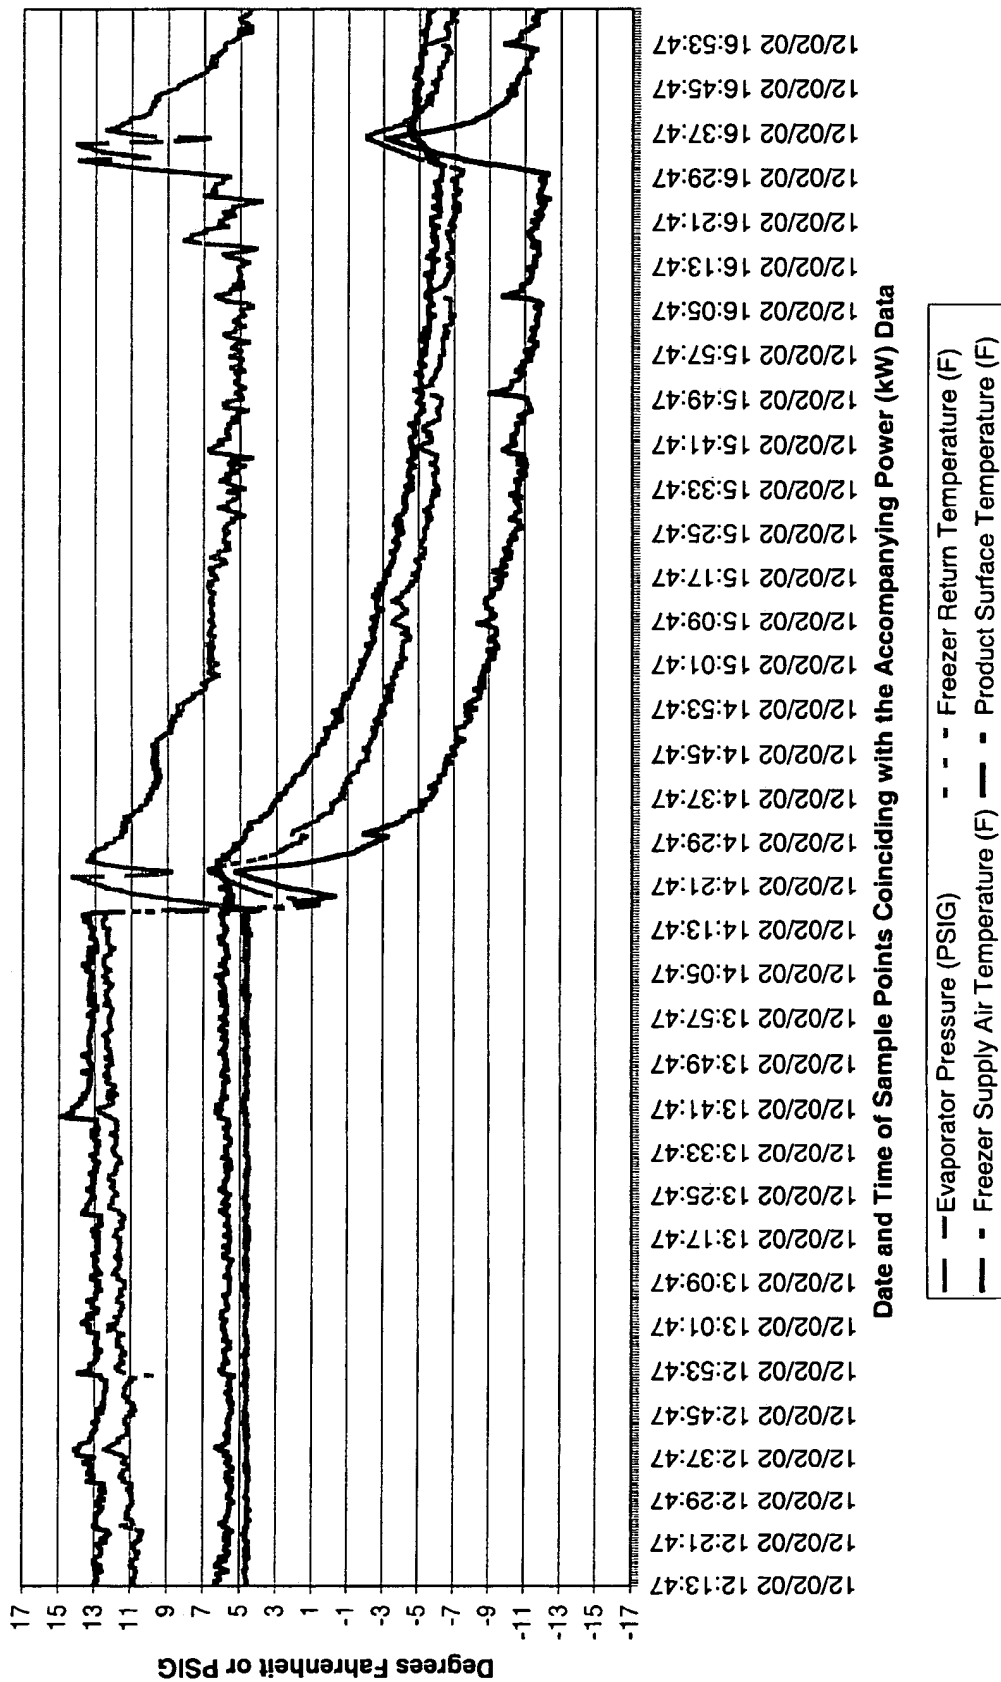


FIG. 3